

Vapor Tight IH

GLI-VTIH

INSTALL AND MAINTENANCE MANUAL

WARNING

1. Read all instructions.
2. Install in accordance with national and local electrical code regulations.
3. This product is intended to be installed and serviced by a qualified, licensed electrician.
4. Turn off electrical power before installing or servicing luminaire in any way.
5. To reduce the risk of fire and overheating, make sure all connections are tight.



**May result in serious injury or death.
Turn power OFF at circuit breaker
prior to installation or servicing.**

Vapor Tight IH

CAUTION

- Before connecting the light, verify that the input voltage is compatible to prevent damage.
- Carefully check for any signs of damage upon opening the package.
- Before connecting to the power supply, switch off the breaker and verify that it is off to prevent electric shock.
- To prevent damage, avoid exposing wiring to sharp edges or objects.
- For safety reasons, please do not connect more than 4 units of 4ft LED lamps in a row, or more than 3 units of 8ft LED lamps in a row.
- Ensure there is enough space to accommodate heat dissipation.
- Ambient Temperature: -10°C to +45°C
- Avoid exposure to direct sunlight.
- Quality will not be affected by small noises when shaking.

ACCESSORIES

Linking Cable



Power Cable



Mounting Clips



Screws 1



Flanged Anchor



Screws 2



Suspension Cable Base



Suspension Cable



Vapor Tight IH

INSTALLATION INSTRUCTIONS

SURFACE MOUNTED INSTALLATION

1. Install suitable anchors to support the fixture (Fig. 1 & 2)
2. Secure the mounting clips to the mounting anchors using suitable fasteners (Fig. 3)
3. Align the back of the lamp to the clips on the ceiling and press the fixture to the mounting clips. (Fig. 4)

Fig. 1

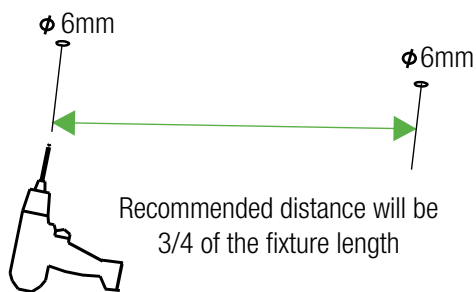


Fig. 2

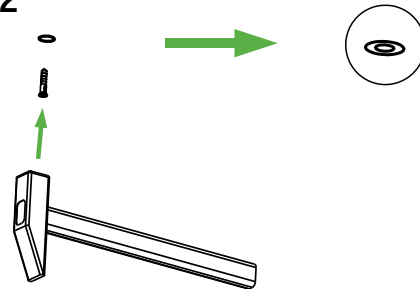


Fig. 3


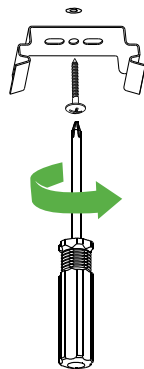


Fig. 4

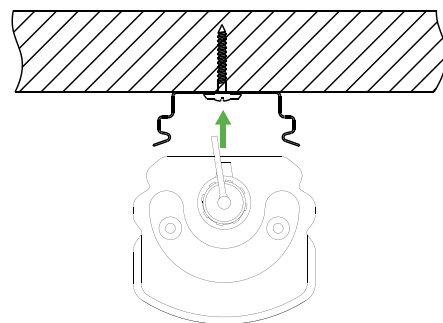

Vapor Tight IH

INSTALLATION INSTRUCTIONS

SUSPENDED INSTALLATION

1. Install suitable anchors to support the fixture (Fig. 5 & 6)
2. Use screws 1 to secure suspension cable gripper base to the ceiling. (Fig. 7)
3. Thread the suspension cable through the base. Lock the cable by turning the end cap. (Fig. 7)
4. Install the mounting clip to the suspension cable using screw 2. (Fig. 8)
5. Press the fixture to the mounting clips. (Fig. 9)
6. Press the small round tube of the gripper and pull cable to adjust the height of the fixture. (Fig. 9)

Fig. 5

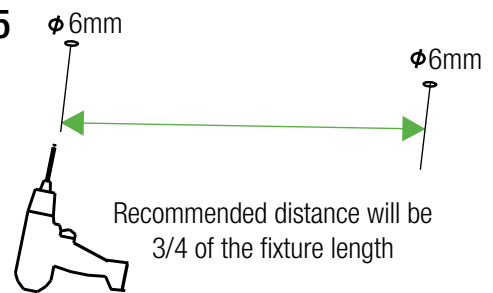


Fig. 6

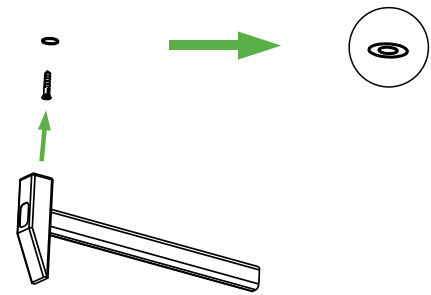


Fig. 7

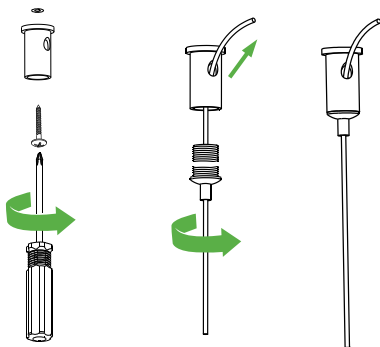


Fig. 8

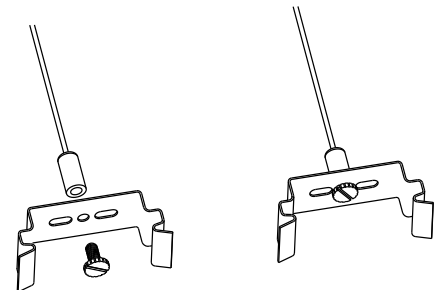


Fig. 9



Vapor Tight IH

INSTALLATION INSTRUCTIONS

WIRING

1. Open the cap at the fixture end. (Fig. 10)
2. Attach the power cable, ensuring the connector notch is aligned. (Fig. 11)
3. Tighten the connector nut.
4. Wire according to the diagram. (Fig. 12)

LINKING FIXTURES

1. Open the cap at both fixture ends. (Fig. 10)
2. Attach the linking cable, ensuring the connector notch is aligned. (Fig. 11)
3. Tighten the connector nuts.

NOTE: For safety, DO NOT connect more than 4pcs 4ft LED lamp in a row; do not connect more than 3pcs 8ft LED lamp in a row.

Fig. 10

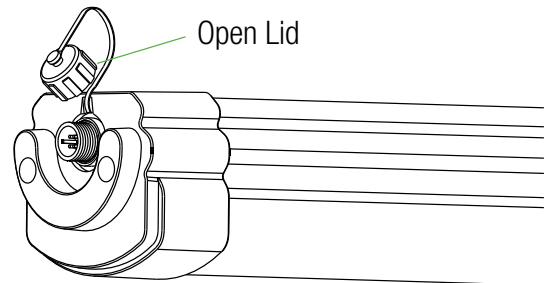


Fig. 11

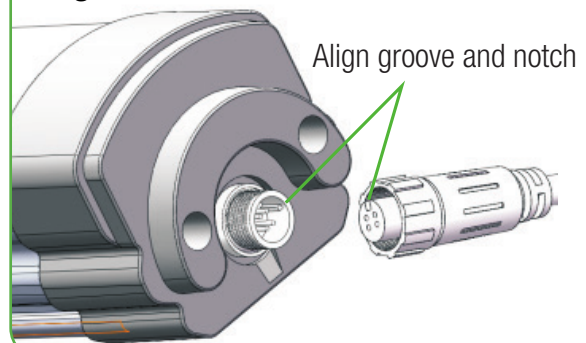


Fig. 12

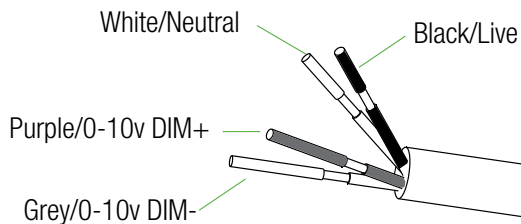


Fig. 13

