

Vapor Tight Luminaire C

GLI-VTLC

INSTALL AND MAINTENANCE MANUAL

WARNING

1. Read all instructions.
2. Install in accordance with national and local electrical code regulations.
3. This product is intended to be installed and serviced by a qualified, licensed electrician.
4. Turn off electrical power before installing or servicing luminaire in any way.
5. To reduce the risk of fire and overheating, make sure all connections are tight.



**May result in serious injury or death.
Turn power OFF at circuit breaker
prior to installation or servicing.**

Vapor Tight Luminaire C

CAUTION

- Check input voltage before connecting the fixture to avoid damage.
- The installation and removal of lamps require professional technical personnel to operate.
- Check for signs of damage when opening the package. If broken glass is found, reach out for replacement.
- Professional technical personnel is required to operate, install or remove the track system.
- To avoid electric shock, turn off all lighting fixtures when connected to the power supply.
- Luminaire must be supplied by a wiring system with an equipment grounding conductor.
- Caution: burn hazard. Ensure lens and housing are cool during maintenance.
- Ensure the wire supply voltage is the same as luminaire supply to avoid degradation.
- Use proper supply wiring as specified on the luminaire nameplate.
- DO NOT USE in environments containing sulfur, chlorine, or other halides, methyl acetate, cyanoacrylates, glycol ethers, formaldehyde or butadiene.
- DO NOT restrict or cover luminaire ventilation.
- DO NOT cover with material that will prevent convection or conduction cooling.
- Ensure correct polarity before installation.
- DO NOT expose wiring to sheet metal edges or other sharp objects to avoid wiring damage.

INSTALLATION INSTRUCTIONS


PRE-INSTALLATION

Before beginning installation, turn OFF power from the electrical panel.

Take the fixture and components out of the package. In case of missing parts, do not assemble, install, or operate this light fixture.

MAINTENANCE

Regularly inspect luminaire visually, electrically (ensure that all connections are clean and tight), and mechanically (ensure all parts are properly assembled), depending on the environment and frequency of use. Suggested time is at least once a year.

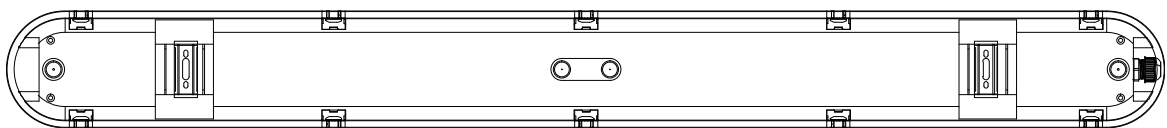


Vapor Tight Luminaire C

INSTALLATION INSTRUCTIONS

INSTALLATION

Installation

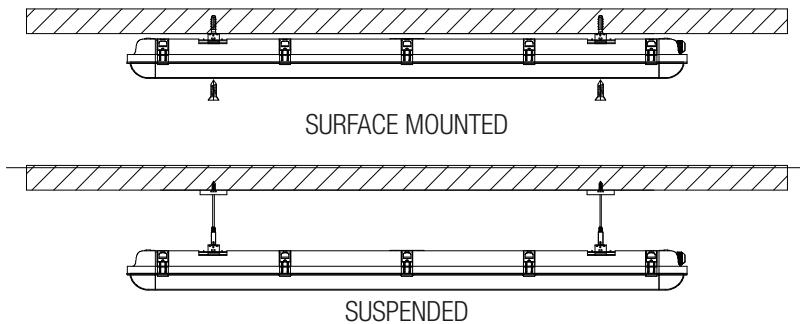

DISASSEMBLY


STEP 1

Open the latches securing the lens to the housing.

STEP 2

Remove the lens.

1

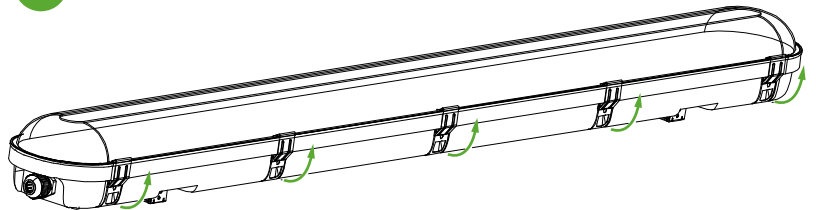

ASSEMBLY


STEP 2

Place lens over housing.

STEP 1

Secure the lens to the housing by closing the latches firmly.

2

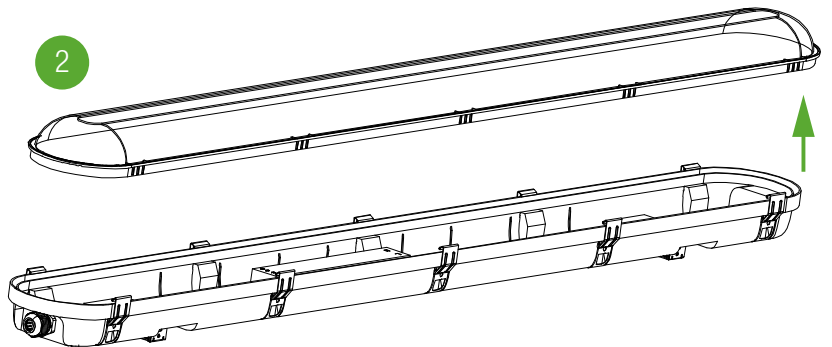

Vapor Tight Luminaire C

INSTALLATION INSTRUCTIONS

WIRING DIAGRAM

